

Number	20-001867-PR06 (NW-K20-06-en-01)
Owner	GEALAN Fenster-Systeme GmbH Hofer Str. 80 95145 Oberkotzau Germany
Product	Plastic profile, profile combination: casement member - frame member
Designation	System: GEALAN-LINEAR
Details	Material Polyvinyl Chloride unplasticized (PVC-U); Projected width 110 mm; Structural depth 74 mm; Casement: Designation 7072; Cross section (W x T) 72 mm x 74 mm; Thickness of infill 36 mm; Edge cover of infill 15 mm; Reinforcement material Steel - galvanized Steel; Reinforcement designation 7727; Frame member: Designation 7001; Cross section (W x T) 72 mm x 74 mm; Reinforcement material Steel - galvanized Steel; Reinforcement designation 8727
Special features	
Result	Thermal transmittance according to EN 12412-2:2003-07  $U_f = 1.3 \text{ W/(m}^2\text{K)}$


Basis *)

EN 12412-2:2003-07

*) and corresponding national versions
(e.g. DIN EN)

Test report: 20-001867-PR06 PB-K20-06-de-01

Representation

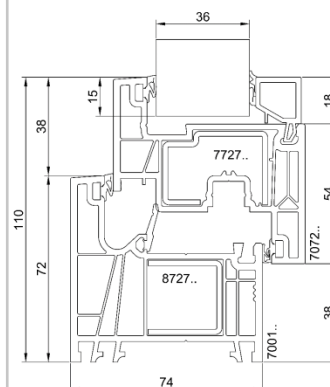

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit.

When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and results given relate solely to the tested/described specimen. This test/evaluation does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim
16.11.2020



Konrad Huber, Dipl.-Ing. (FH)
Head of Testing Department
Building Physics



Stefan Junker, Dipl.-Ing. (FH)
Operating Testing Officer
Building Physics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: 84B-C9E1B