

Number	20-002280-PR02 (NW T02-A01-04-en-01)
Owner	GEALAN Fenster-Systeme GmbH Hofer Str. 80 95145 Oberkotzau Germany
Product	Single window
Designation	Shipping name: Linear
Details	Manufacturer GEALAN Fenster-Systeme GmbH, - Oberkotzau; Type of opening Tilt and turn; Overall dimensions (W x H) 1230 mm x 1480 mm; Rebate seal levels 3; Mass, area-related 52.6 kg/m ² ; Number of casements 1; IGU: Glass configuration 8 LSG (acoustic foil) / 12 cavity (Ar) / 4 float / 12 cavity (Ar) / 8 LSG (acoustic foil); Frame member: Designation 7001; Material Unplasticised polyvinyl chloride (uPVC), with reinforcement; Projected width 72 mm; Structural depth 74 mm; Casement member: Designation 7072; Material Unplasticised polyvinyl chloride (uPVC), with reinforcement; Projected width 72 mm; Structural depth 74 mm

Special features

Result

Weighted Sound Reduction Index R_w and Spectrum-Adaptation Terms C and C_{tr} according to EN ISO 10140-2: 2010-09, EN ISO 717-1: 2013-03




$$R_w (C; C_{tr}) = 47 (-2; -4) \text{ dB}$$

Basis *)

EN ISO 10140-2:2010-09
EN ISO 717-1:2013-03
EN ISO 10140-1:2016-08
*) and corresponding national versions (e.g. DIN EN)

Test report: 20-002280-PR02 PB
T02-A01-04-de-01

Representation

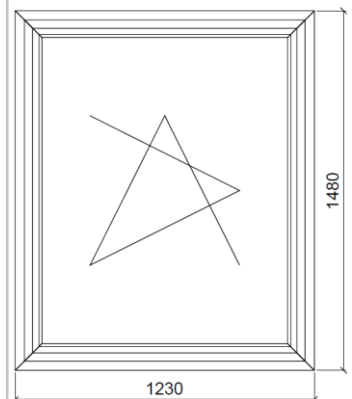

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit.
When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim

07.01.2021



Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics



Johann Baume, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: 68E-09211